



**Institute for Building Energetics,
Thermotechnology and Energy Storage**
Research and Testing Center for Thermal Solar
Systems (TZS)
University of Stuttgart



Test Report

Hot Water Store

Determination of heat losses according to EN 12977-3:2018

Test Report No.: 23STO444OEM02

Stuttgart, February 19th, 2024

Claimant: THERMIC S.P.L.L.C.
LOUTSAS & MESOLOGGIU
19600 MANDRA, ATTICA
GREECE


Manufacturer: THERMIC S.P.L.L.C.
Store Type: BLT.ECOGL.160.DE
Construction Year: 2023

Contents

	Page
1 Technical Data.....	3
2 Schematic design.....	4
3 Test results.....	5
3.1 Geometrical Data.....	5
3.2 Volumes.....	5
3.3 Thermal parameters.....	5
4 Test occurrences.....	6
5 General.....	6
Appendix A: Explanations.....	7

1 Technical Data¹			
Manufacturer:		Type:	
THERMIC S.P.L.L.C.		BLT.ECOGL.160.DE	
Year:	Serial No.:	Nominal volume:	Design:
2023	02463/23	148 liters	Horizontal thermosiphon solar domestic hot water store
Heat output or coefficient of performance:		Test acc. to DIN 4753	Weight (empty):
not specified		not specified	not specified
Water volume:			
Corrosion protection:		Enamel Powder Coated, Magnesium Anode	
Max operation pressure:		8 bar	
Max operation temperature:		95 °C	
Thermal insulation:		Polyurethane: 50 mm	
Mantle Heat exchanger			
Max operation pressure [bar]:		3.0	
Max operation temperature [°C]:		95	
Volume of heat exchanger [liters]:		6.6	
Area [m ²]:		0.625	

¹ as stated by the manufacturer

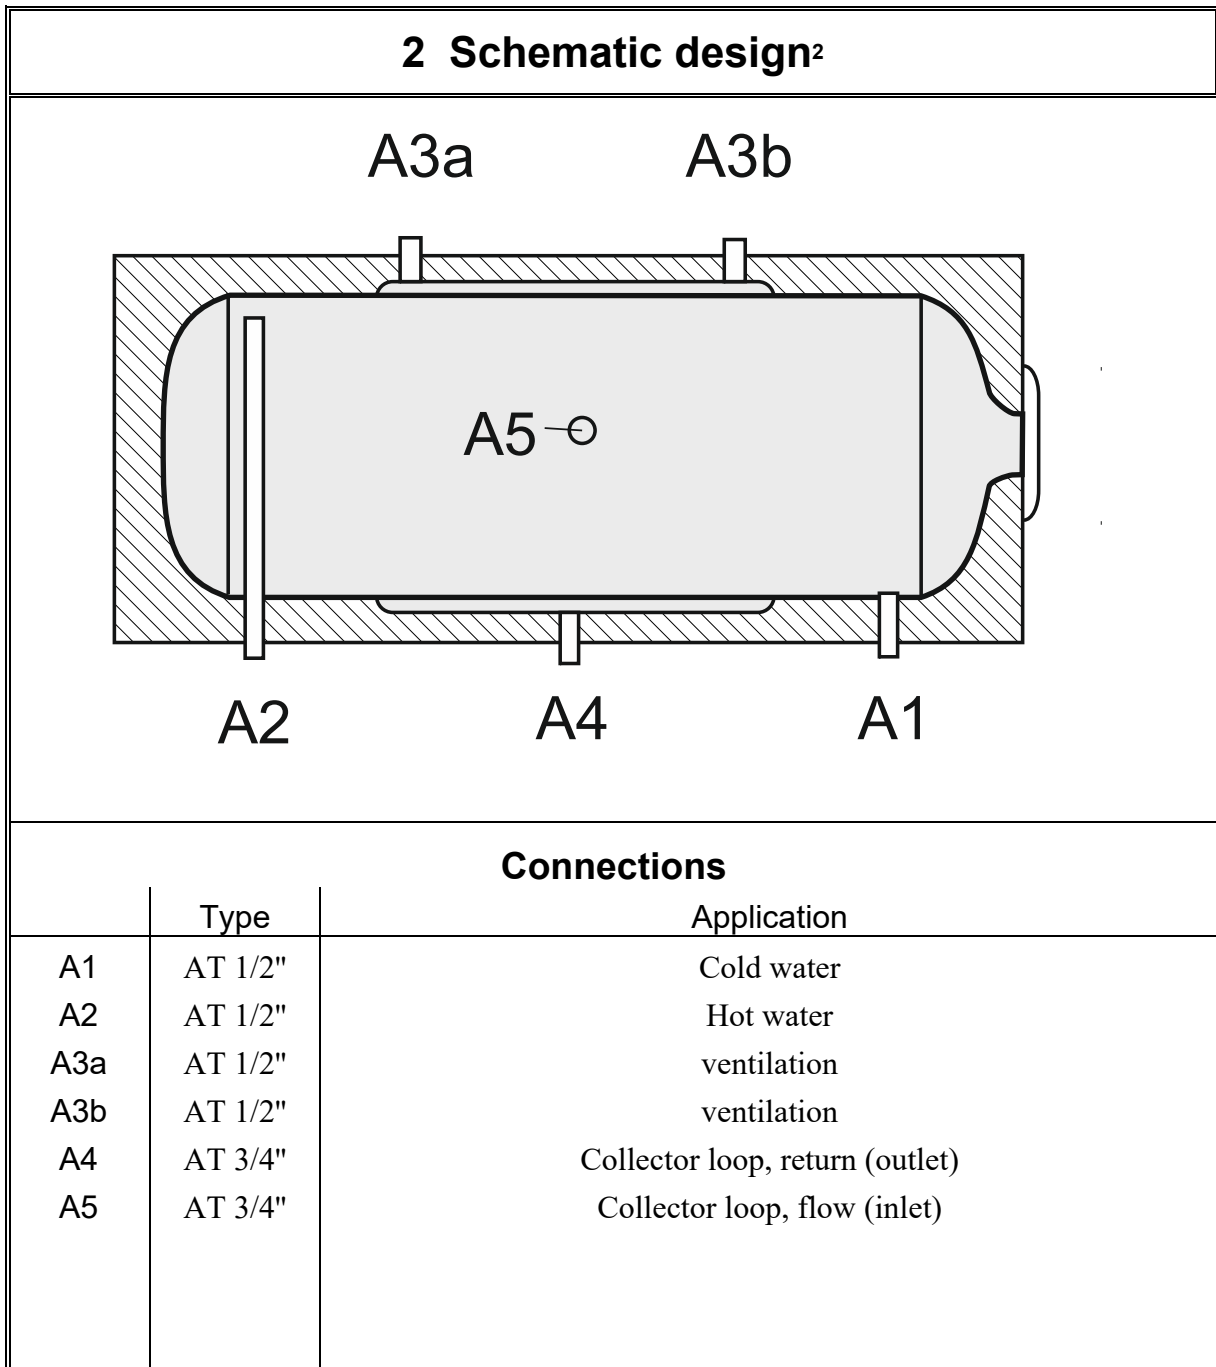

AT = outside thread

IT = inside thread

² as stated by the manufacturer

3 Test results

3.1 Geometrical Data			
Maximum length:	Max.diameter:	Height of water volume:	Diameter of water volume:
1.30 m	0.50 m	0.40 m	0.40 m
3.2 Volumes			
Domestic hot water volume:		Heat exchanger:	
141.6 liters		4.5 liters	
3.3 Thermal parameters			
Heat loss capacity rate (standby):	Standing loss power S ³ :	Thermal losses Q _{PR} ³	
1.43 W/K	64.4 W	1.55 kWh/24h	

Table 1: Equivalent Energy efficiency classes for a hot water store with a rated capacity of 148.0 l according to SASO 2884:2017

Equivalent energy efficiency class	Daily thermal losses limit value [kWh/24h]
A	0.69
B	0.96
C	1.19
D	1.86
E	2.33
F	3.04
G	> 3.04

³ at a temperature difference of 45 K

4 Test occurrences

No special incidents

5 General

The thermal testing of the store was performed according to EN 12977-3:2018 '*Thermal solar systems and components, Custom built systems, Part 3: Performance test methods for solar water heater stores*'.

The **bold** printed values were determined by means of parameter identification.

The determined results are only valid for the tested version of the test sample.


Water was used as heat transfer fluid.

The reproduction of **single pages** of this test report is not allowed without permission of IGTE.

The nomenclature of SASO 2884:2017 and EN 12977-3:2018 was used.

Arrival of test sample:	07.03.2023
Testing period:	10.03. bis 13.03.2023
Test location:	Stuttgart, Pfaffenwaldring 10
Identification of test sample:	Adhesive label: 23STO444
Test engineer:	Dipl.-Ing. S. Bachmann

Stuttgart, February 19th, 2024

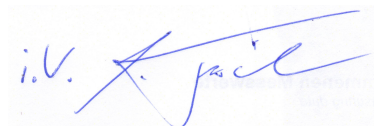

Dr.-Ing. Harald Drück

- Head Solar Testing-

Authentication: Test report available by the following [link](#)

Appendix A: Explanations

The following pages contain additional explanations and information related to the store test report. For a better understanding, some facts will be explained by examples and complex correlations will be shown in a simplified way.

Definition of terms

For the tested store the hot water is heated before draw off and then kept ready for use. According to DIN 4753 (water heaters and water heating installations for drinking water and service water) these stores or water heaters are named **store-water heaters**. For better readability of this text the term **store** is used in the following.

1 Schematic Design

Here the schematic design of the store as well as the positions of the connections and temperature sensors are shown according to the specifications of the manufacturer.

2 Test results

The *maximum length* and the *maximum diameter* have been measured at the test sample equipped with thermal insulation.

The *diameter of the water volume* was taken from the documentation.

The *height of the water volume* corresponds to the *diameter of the water volume*.

For the determination of all *thermal parameters* water was used as heat transfer fluid. Here the thermophysical properties for the density ($\rho = 992.42 \text{ kg/m}^3$) and the specific heat capacity ($c_p = 4.181 \text{ kJ/(kg}\cdot\text{K)}$), averaged over the common range of the operating temperature ($15^\circ\text{C} - 60^\circ\text{C}$) are assumed to be constant.

The *heat loss capacity rate* describes the heat losses from store to ambient per Kelvin temperature difference (between store and ambient). For this purpose, the hot water store was charged via connections A5 (inlet) and A4 (outlet) with a capacity of 1.5 kW and a volume flow of approx. 180 l/h until the outlet temperature reached 60°C . This was followed by a standby phase of 48 h. After this, the hot water store was discharged via connections A1 (inlet) and A2 (outlet) at a constant inlet temperature of 20°C and a volume flow of approx. 150 l/h.

The meaning of the heat loss capacity rate is illustrated in the following example for a solar domestic hot water system.

Example for the heat loss capacity rate of the store:

If the entire store has a uniform temperature of 60°C located in a room with a temperature of 20°C the relevant temperature difference between the water in the store and the ambient is 40 K. Furthermore assuming a heat loss capacity rate of 2,5 W/K the flow of heat loss \dot{Q}_{loss} from the store to the ambient is calculated according to the following equation:

$$\dot{Q}_{loss} = 2,5 \text{ W/K} \cdot (60 - 20)\text{K} = 100 \text{ W}$$

100 W seems to be a marginal power compared to the power of the collector field which is about 2500 W (irradiation 800 W/m², collector area 5 m², $\eta = 80\%$). However the heat losses occur for 24 hours a day, and so the store is losing 2,4 kWh each day. Compared with the daily hot water energy consumption of 8 kWh, (typical for a four person household), the energy loss is about 30%! As shown by this example, the heat loss capacity rate has an important influence on the performance of the system. Hence it should be as low as possible.